

NOTES: MATERIAL REQUIREMENTS:

1. GALVANIZED STEEL RAILING SHALL BE USED. ALUMINUM MAY BE USED IN DOWNTOWN BELLEVUE.

GENERAL REQUIREMENTS:


1. SHOP DRAWINGS OF RAILING SHALL BE SUBMITTED FOR APPROVAL SHOWING COMPLETE DIMENSIONS AND DETAILS OF FABRICATION AND INCLUDING AN ERECTION DIAGRAM. MATERIALS BEING USED SHALL BE SPECIFIED IN THE SHOP DRAWINGS.
2. PIPE RAILING, PIPE BALUSTERS AND PIPE RAILING SPLICES SHALL BE ADEQUATELY WRAPPED TO ENSURE SURFACE PROTECTION DURING HANDLING AND TRANSPORTATION TO THE JOB SITE.
3. CUTTING SHALL BE DONE BY SAWING OR MILLING AND ALL CUTS SHALL BE TRUE AND SMOOTH. FLAME CUTTING WILL NOT BE PERMITTED.
4. ALLOW FOR EXPANSION AT APPROXIMATELY EVERY FOURTH POST.
5. ONLY USE PANEL HEIGHT OF 36 INCHES AFTER APPROVAL OF THE TRAFFIC ENGINEER.
6. SLEEVES SHALL BE SCHEDULE 40 PVC AND HAVE AN INSIDE DIAMETER 2 INCHES LARGER THAN THE POST OUTSIDE DIAMETER. IF RAILING IS TO BE INSTALLED IN EXISTING SIDEWALK, HOLES SHALL BE CORE DRILLED 2 INCHES LARGER THAN THE OUTSIDE DIAMETER OF THE POST, AND NO LESS THAN 6" FROM THE EDGE OF CONCRETE.
7. AVOID PLACING SAFETY RAIL IN SIGHT LINES. SEE STD. DWGS. TE-1 THROUGH TE-3.
8. SEE DESIGN STANDARD 13 FOR ADDITIONAL INFORMATION.

ALUMINUM RAILING REQUIREMENTS:

1. RAILING SHALL BE CV PIPE RAIL OR APPROVED EQUIVALENT. INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS. BALUSTERS SHALL BE SOLID ALUMINUM FULL WELDED IN PLACE.
2. ALL ALUMINUM PARTS SHALL BE GIVEN A CLEAR ANODIC COATING AT LEAST 0.0006 INCH THICK AND BE HOT WATER SEALED AND SHALL HAVE A UNIFORM FINISH.
3. PIPE RAILING AND PIPE RAILING SPLICES MAY BE HEATED TO NOT MORE THAN 400°F FOR A PERIOD NOT TO EXCEED 30 MINUTES TO FACILITATE FORMING OR BENDING.
4. WELDING OF ALUMINUM SHALL BE IN ACCORDANCE WITH THE LATEST AASHTO STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS.
5. RAILS, POSTS AND FORMED ELBOWS SHALL BE A.S.T.M. B-241 OR B-429 ALLOW 6063-T6 SCHEDULE 40 (STD PIPE). BRACKETS, END CAPS AND OTHER FITTINGS SHALL BE A.S.T.M. 6063-T5. SPLICES AND REINFORCING SLEEVES SHALL BE DRAWN ALUMINUM TUBING 6063-T832. SLEEVE I.D. SHALL BE 1" GREATER THAN POST O.D.

STEEL RAILING REQUIREMENTS:

1. POST AND RAIL MATERIAL SHALL BE SCHEDULE 40 STEEL PIPE CONFORMING TO ASTM A 53, GRADE B. BALUSTERS SHALL BE SOLID STEEL BARS CONFORMING TO AASHTO M 183.
2. SPOT WELDING IS NOT ALLOWED. ALL WELDS SHALL ENCOMPASS THE ENTIRE JOINT.
3. SAFETY RAILING WILL BE HOT DIPPED GALVANIZED AFTER FABRICATION.
4. ANY FIELD CUTTING OR WELDING AREAS SHALL BE GROUND SMOOTH AND COATED WITH AT LEAST 2 COATS OF COLD GALVANIZED PAINT.

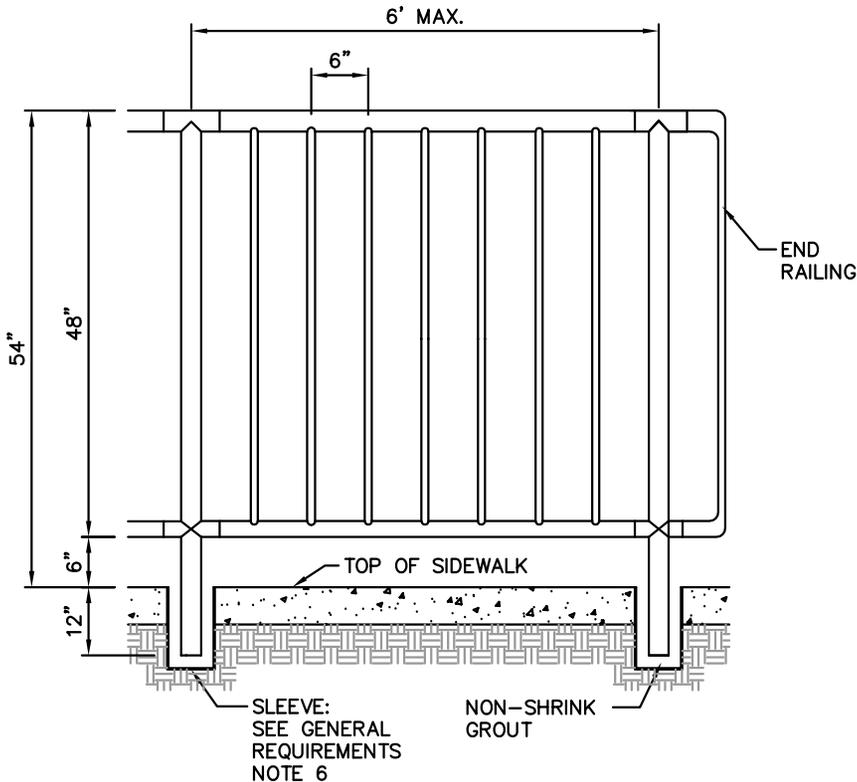

MATERIAL DIMENSIONS

PANEL HEIGHT	TOP RAIL/POST	BOTTOM RAIL	BALUSTER
48"	2½" NOM.	2" NOM.	7/8" Ø BAR
*36"	1½" NOM.	1½" NOM.	7/8" Ø BAR

* BEFORE USE SEE GENERAL NOTE 5.



METAL SAFETY RAILING

DRAWING NUMBER	TE-34
SCALE	NONE
REVISION DATE	03/15
DEPARTMENT	TRANS