


NOTE:

1. THE COVER SHALL HAVE 1/16" TO 1/8" CLEARANCE ON EACH EDGE WITHIN THE FRAME GALVANIZING
2. CONDUIT ELBOWS OR SWEEPS INTO JUNCTION BOX SHALL BE DETERMINED IN THE FIELD BY THE INSPECTOR.
3. DISTANCE BETWEEN THE TOP OF THE CONDUIT AND THE BOTTOM OF THE LID SHALL BE 10" MIN. TO 12" MAX.

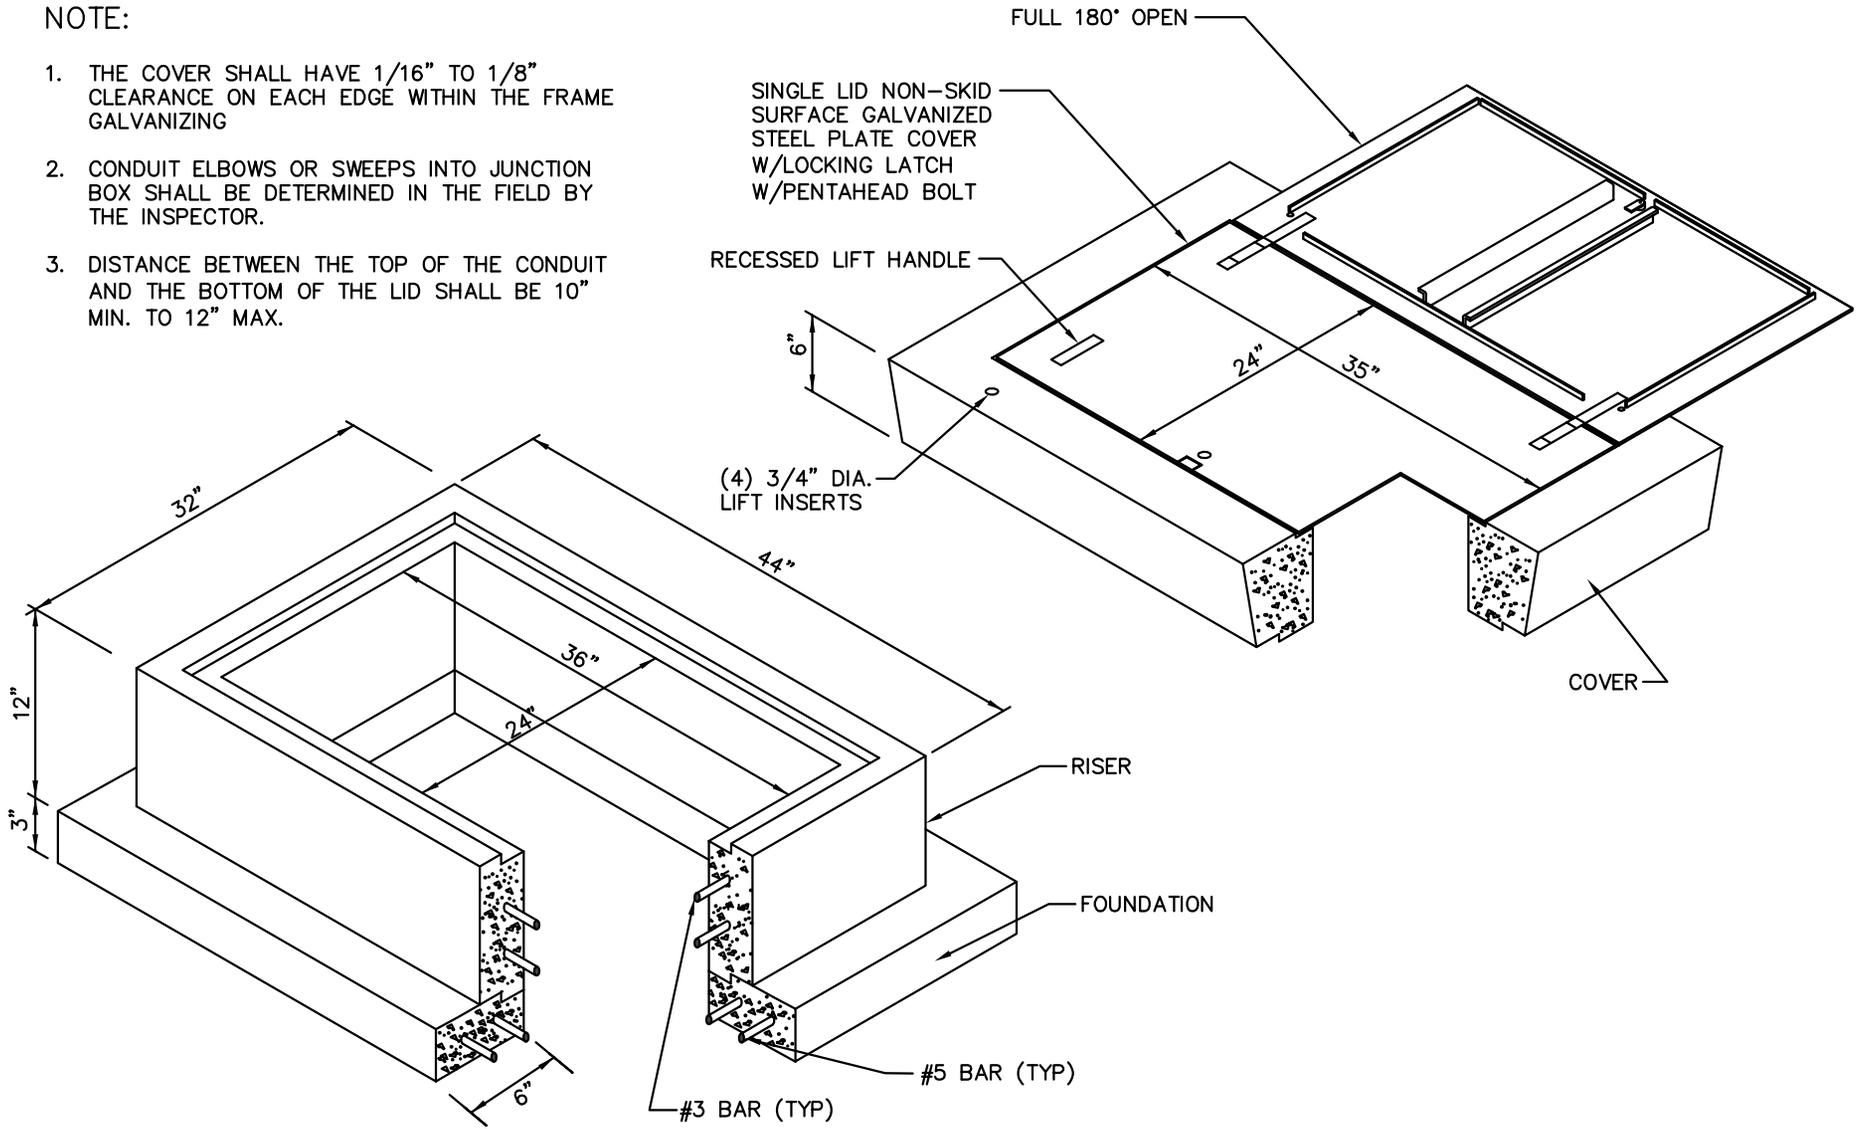

TYPE 8 MODIFIED JUNCTION BOX

DRAWING NUMBER	TSSL-6
SCALE	NONE
REVISION DATE	01/15
DEPARTMENT	TRANS