


HOUSE OVER 2' ABOVE
MAXIMUM HYDRAULIC
GRADIENT OF THE
UPSTREAM PUMP STATION

HOUSE 2' OR LESS ABOVE
THE MAXIMUM HYDRAULIC
GRADIENT OF THE
UPSTREAM PUMP STATION

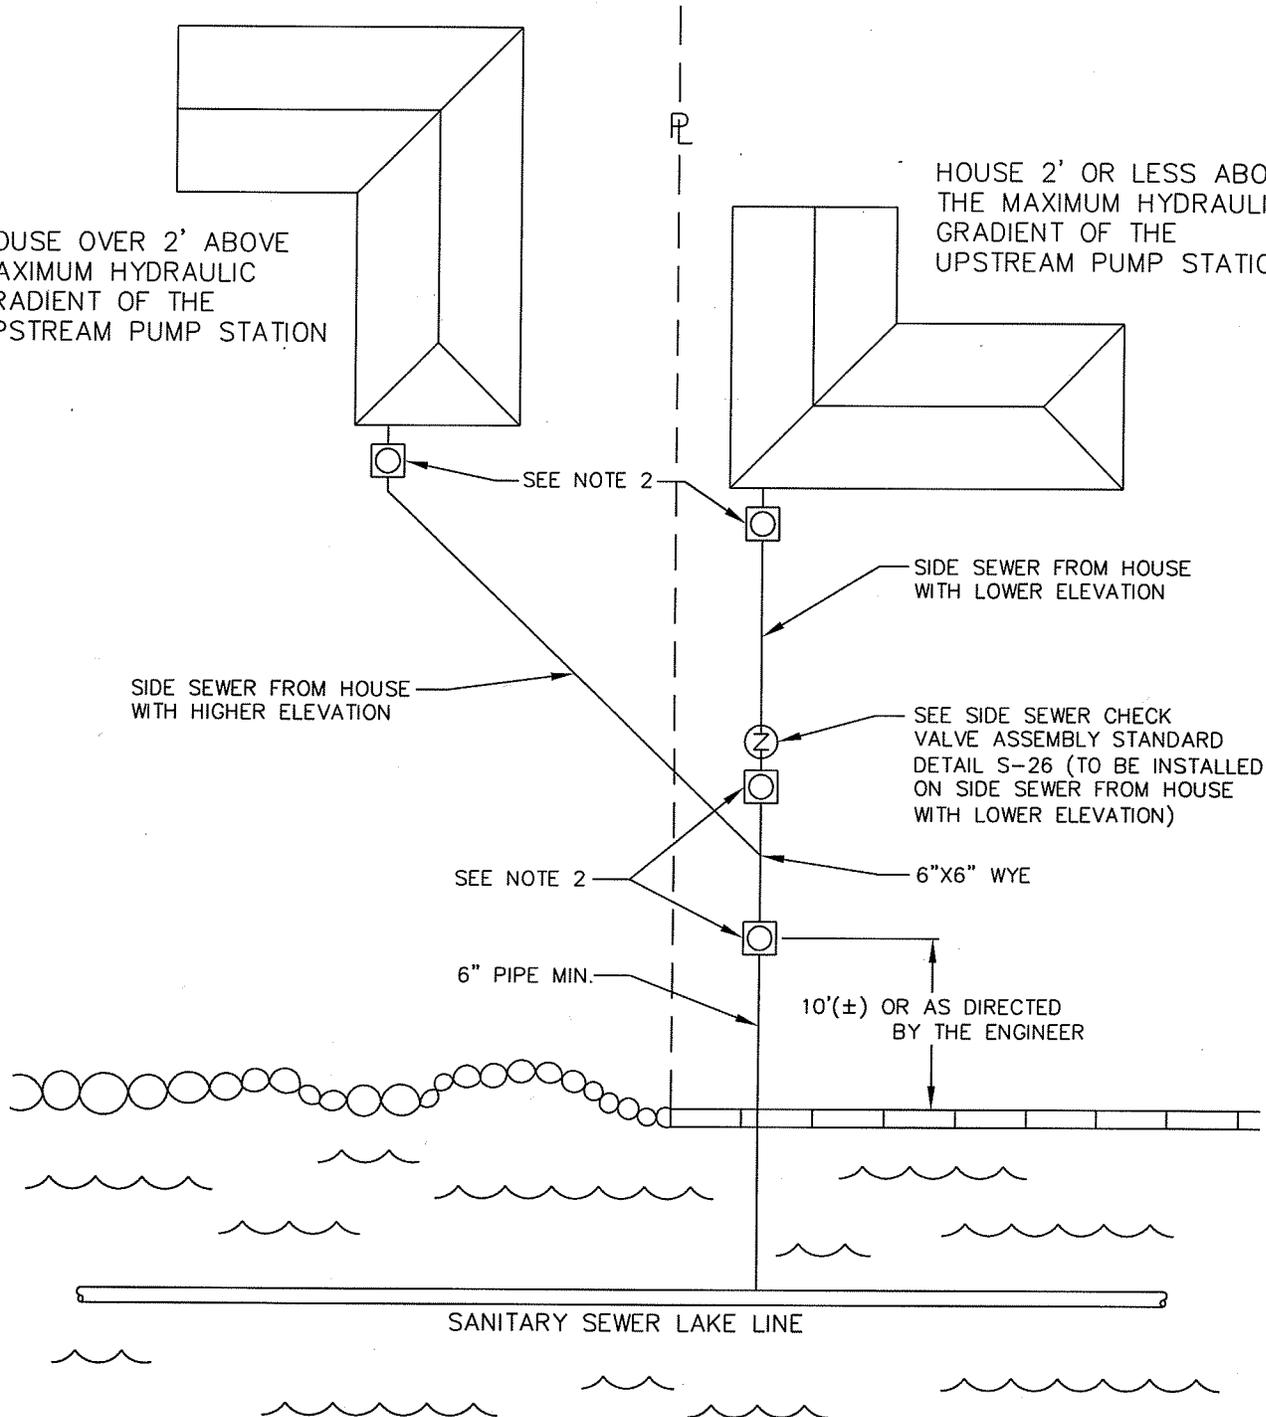

NOTES:

1. CHECK VALVE ASSEMBLY IS PRIVATE AND SHALL BE THE PROPERTY OWNERS RESPONSIBILITY TO MAINTAIN.
2. ALL CLEANOUTS SHALL BE INSTALLED TO GRADE PER STANDARD DETAIL S-25.



City of
Bellevue

SEWER UTILITIES

TITLE

LAKE LINE CLEANOUT AND CHECK
VALVE ASSEMBLY INSTALLATION