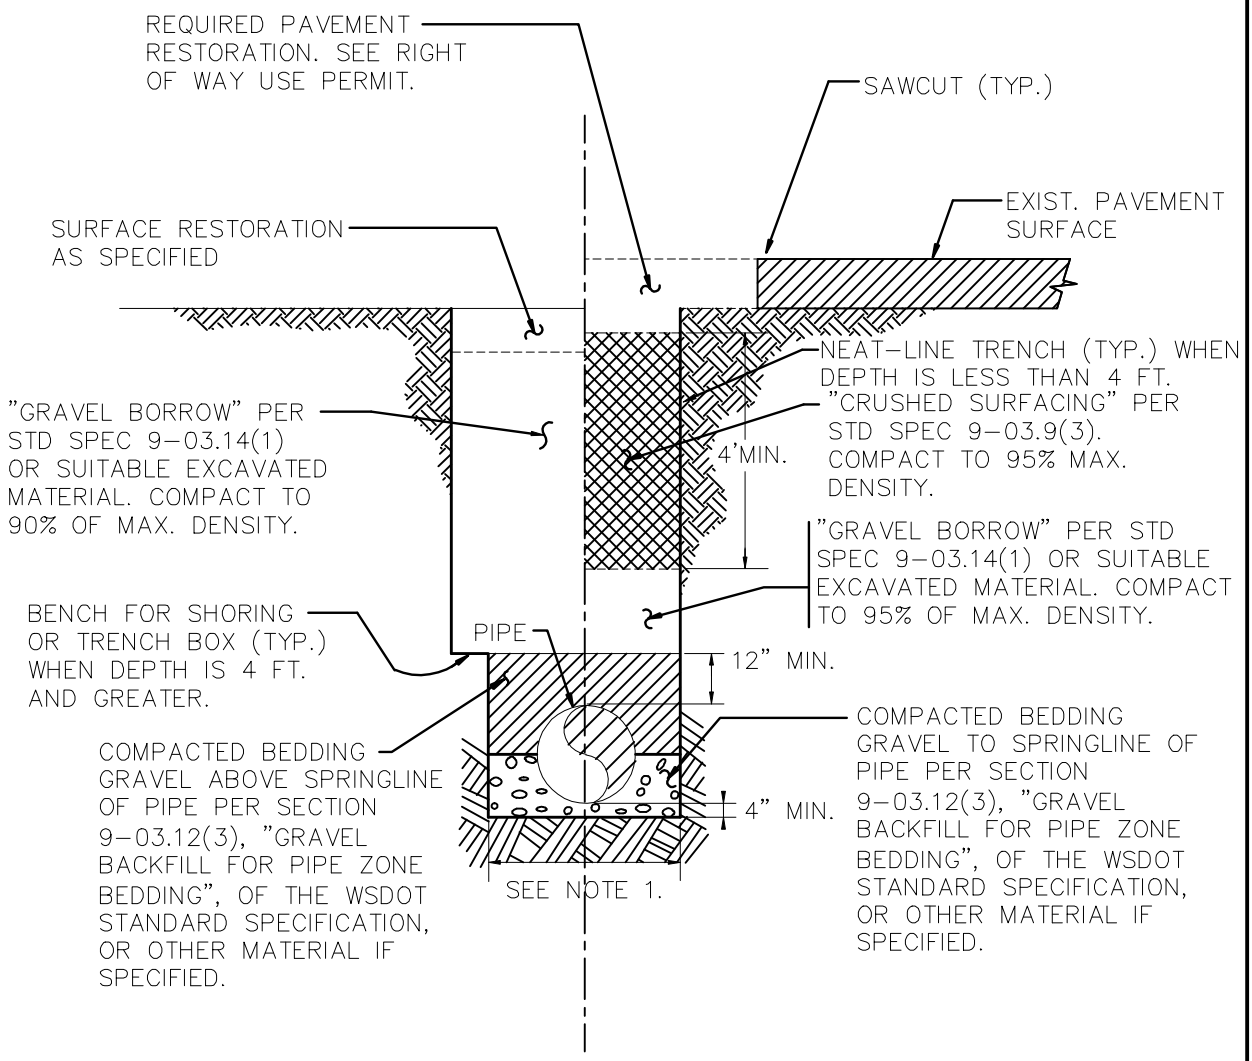

NOTES:

1. MAXIMUM WIDTH OF TRENCH AT TOP OF PIPE:
   * 36" FOR PIPE UP TO AND INCLUDING 12" NOMINAL DIAMETER.
   * I.D. PLUS 18" FOR PIPE LARGER THAN 12" NOMINAL DIAMETER.

City of Bellevue

WATER UTILITY

TITLE

TYPICAL TRENCH DETAIL

JANUARY 2011

NO SCALE

NO. W-6