


# City of Bellevue

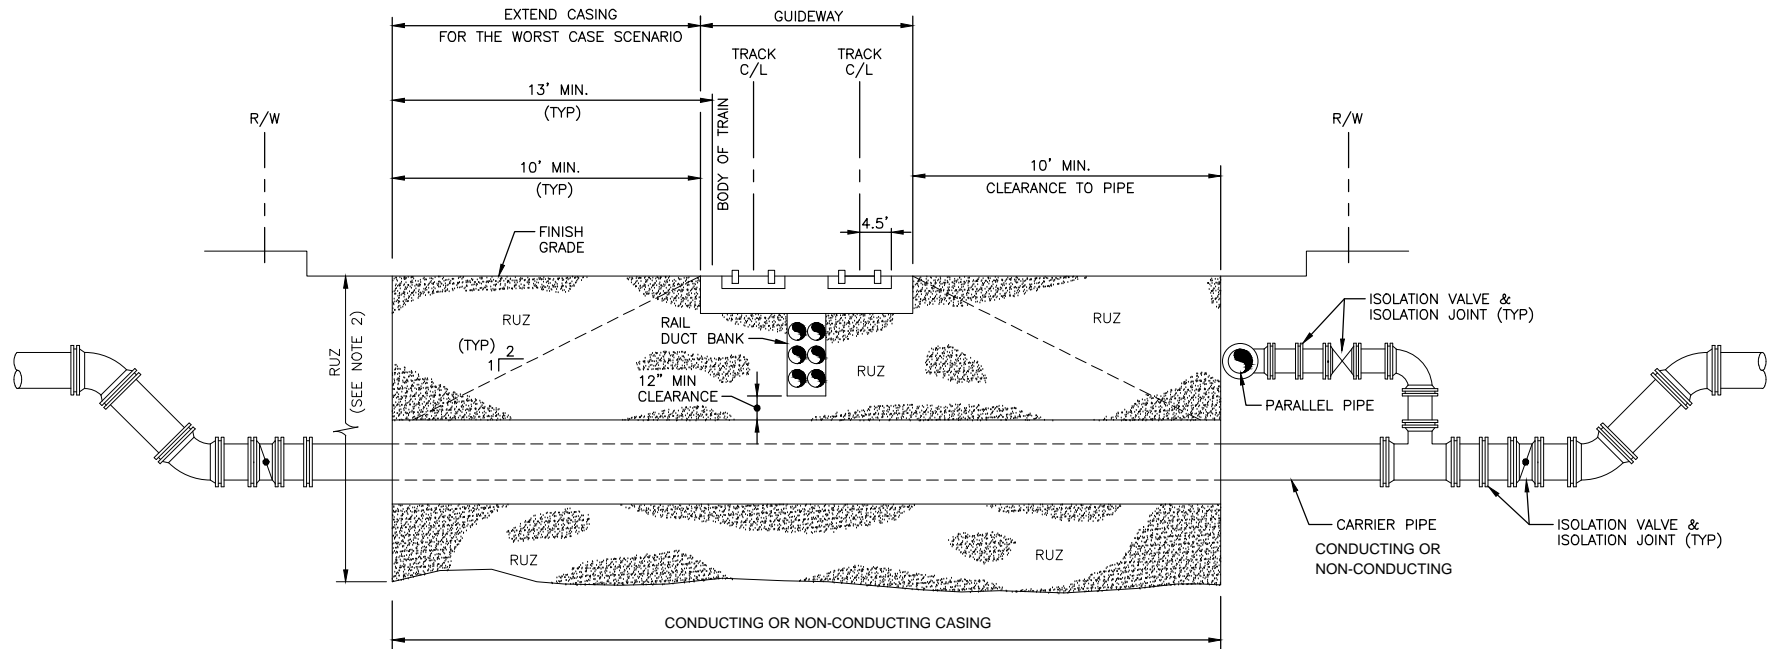

## NOTES:

1. WATER PIPE CROSSING SHOWN, DETAIL FOR OTHER UTILITY CROSSINGS SIMILAR.
2. CONDUCTING CASING AND CARRIER PIPE SHALL BE CATHODICALLY PROTECTED REGARDLESS OF DEPTH. NON-CONDUCTING CARRIER PIPES AND CASINGS ARE NOT CATHODICALLY PROTECTED.
3. PARALLEL PIPE WITHIN 10-FT OF TRACK TO BE RELOCATED.
4. CATHODICALLY PROTECT RELOCATED / NEWLY INSTALLED CONDUCTING CARRIER PIPE AND CASING. NON-CONDUCTING CARRIER PIPES AND CASINGS ARE NOT CATHODICALLY PROTECTED.
5. VERTICAL AND HORIZONTAL THRUST RESTRAINT AND RESTRAINED JOINT PIPE ELEMENTS ARE REQUIRED BUT NOT SHOWN ON THIS DETAIL.

## LEGEND

 RESTRICTED UTILITY ZONE (RUZ)

## PIPE CROSSING DETAIL

N.T.S.