



SLEEVE WRAPPED

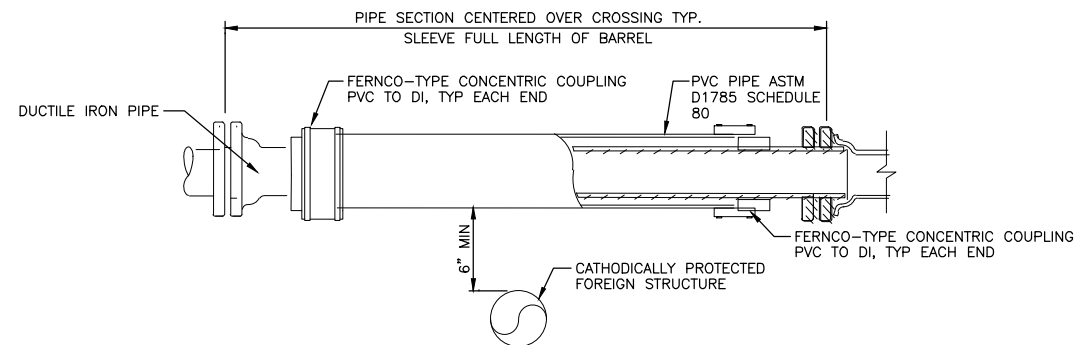


SLEEVE SLIP-ON FOR DI PIPE

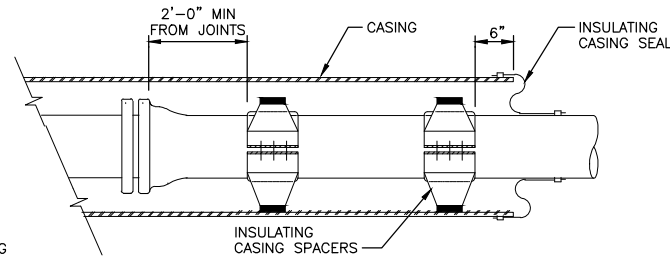

NOTES:

1. PROVIDE A SPACER WITHIN 6" OF EACH CASING END. PROVIDE INTERMEDIATE SPACERS AS REQUIRED, NOT TO EXCEED THE MAXIMUM DISTANCE SPECIFIED BY THE MANUFACTURER.
2. INSTALL CASING SEAL PER MANUFACTURER REQUIREMENTS TO PREVENT TENSIONING SEAL DURING BACKFILL.

CASING SPACERS & END SEALS

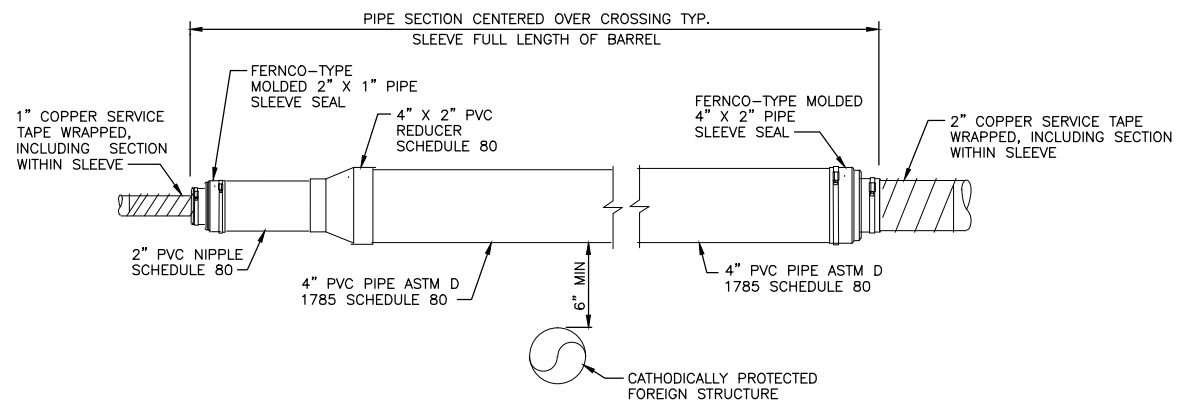


**SLEEVE SLIP-ON FOR COPPER SERVICE
1" OR 2" COPPER SHOWN**

SLEEVED AND CASED PIPE DETAILS

SCALE: NTS

1

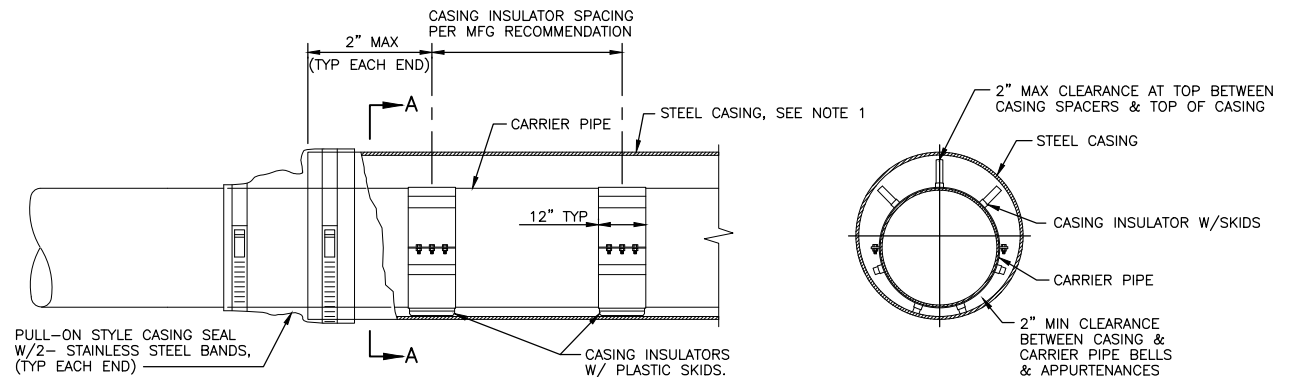

NOTES:

1. SEE SPECIFICATIONS FOR CASING AND CASING COATING REQUIREMENTS.
2. SEE SPECIFICATIONS AND DRAWINGS FOR CASING CATHODIC PROTECTION REQUIREMENTS.
3. SEE DETAIL 2, SHEET 1, FOR CASING TEST STATION REQUIREMENTS.

STEEL CASING DETAIL

SCALE: NTS

2

SECTION A-A

GENERAL NOTES:

1. PROVIDE A SLEEVE WHEN CROSSING OVER OR UNDER POTENTIAL STRAY CURRENT SOURCES.
2. WHEN SLEEVING A PIPE JOINT PROVIDE 2 CASING SPACERS, 1 EACH SIDE OF JOINT.
3. COPPER SHALL BE WRAPPED WITH 20 MIL PVC TAPE, 50% OVERLAP, 40 MIL TOTAL, INSIDE & OUTSIDE PVC SLEEVE.
4. OVERLAP GEOMEMBRANE SHEETING A MINIMUM OF 1/4 THE OF PIPE CIRCUMFERENCE. ENSURE OVERLAP RUNS ALONG CROWN OF PIPE.
5. SLEEVES AND CASINGS SHALL BE DRY & MOISTURE FREE BEFORE SEALING.

January 2025

DESIGNED	ACE	APPROVED	
DRAWN	ACE	SCALE	AS SHOWN
DATE		FILE	X
NO.		BY	
REVISIONS			

0 1" IF THIS BAR IS NOT ONE INCH, THEN ADJUST SCALES ACCORDINGLY

ACE
Consultants, Inc.
Beaverton, Oregon (503) 626-2320

CITY OF BELLEVUE
WASHINGTON

CATHODIC PROTECTION
STANDARD DETAIL - EL - 4