


PLAN VIEW



NOTES:

- LANDSCAPE PLAN IS REQUIRED TO BEAUTIFY OR SCREEN POND.
- 6' MINIMUM TOP WIDTH OF EMBANKMENT, 15' MINIMUM FOR VEHICLE ACCESS TO CONTROL STRUCTURE.
- SCREW TYPE SHEAR GATE REQUIRED FOR ALL SYSTEMS TO BE MAINTAINED BY THE CITY.
- CAPACITY OF OUTLET PIPE MUST BE EQUAL TO OR GREATER THAN DISCHARGE DURING EMERGENCY OVERFLOW CONDITION IF PIPE OVERFLOW IS USED IN LIEU OF SPILLWAY. 8-INCH MINIMUM DIAMETER.
- BERM SLOPE MAY BE 2:1 WHEN TOP SUBMERGED 1' BELOW WATER QUALITY DESIGN W.S.E.
- PENETRATE CARRIER PIPE THROUGH WALL.
- USE APPROVED WATERTIGHT STRUCTURE ADAPTOR.
- SLIP SMOOTH-BORE HORIZONTAL LEG OF FLOW CONTROL TEE INSIDE CARRIER PIPE.
- NO FLOW CONTROL JOINT OUTSIDE OF STRUCTURE.

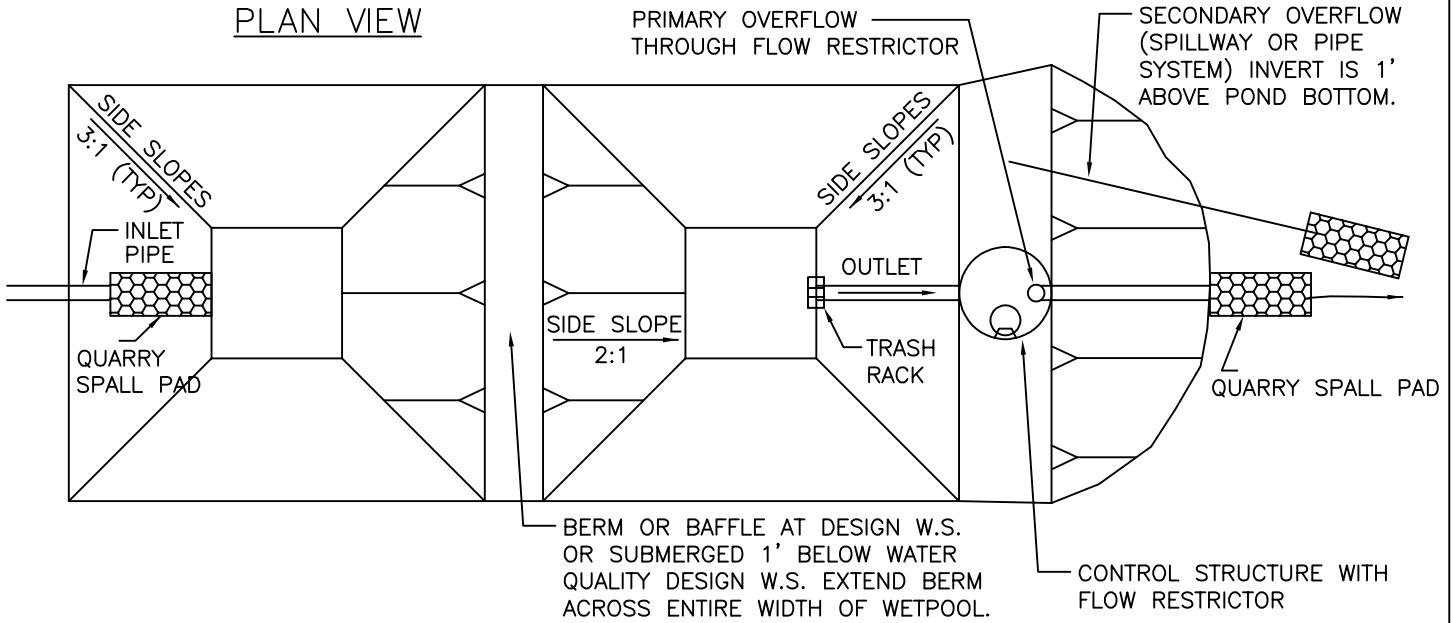

City of  
Bellevue

STORM AND SURFACE  
WATER UTILITY

TITLE

WATER QUALITY POND