


- DUCTILE IRON TEE WITH 4" BRANCH, FL WITH (3) GATE VALVES (ON NEW MAINS), TAPPING TEE WITH 4" BRANCH, FL WITH (1) GATE VALVE (ON EXISTING MAINS).
- 4" GATE VALVE, FL.
- 4" REDUCING COMPANION FLANGE WITH 2" TAP.
- COUPLING, 2" MALE IRON PIPE THREAD BY 2" PACK JOINT (COMPRESSION FITTING) FOR COPPER, FORD C14-87, MUELLER NO. H-15451, OR APPROVED EQUAL.
- 2" COPPER TUBING, TYPE K.
- 2" STREET ELL, BRASS, FEMALE IRON PIPE THREAD BY FEMALE IRON PIPE THREAD.
- 2" NIPPLE, BRASS, M.I.P.T. x M.I.P.T., LENGTH AS REQUIRED TO MEET PROPER GRADE.
- 2" BRASS AND COPPER METER SETTER WITH LOW BYPASS:
 - -FLANGED BALL METER VALVE ON INLET AND OUTLET
 - -BALL VALVE ON BYPASS
 - -PADLOCK WINGS ON ALL VALVES
 - -VERTICAL INLET AND OUTLET, F.I.P.T.
 - -BUSHING INCLUDED ON OUTLET
 - FORD VBB877-12B-11-77 WITH LOW BYPASS OR A.Y. MCDONALD 730B712WWFF665 VERTICAL METER SETTER WITH VALVE ROTATED 90 DEG., OR APPROVED EQUAL.
- RIGID METER SPREADER, SUPPLIED BY CITY OF BELLEVUE, TO BE INSTALLED IN METER SETTER BY CONTRACTOR.
- METER BOX: CARSON INDUSTRIES 1730-18 BCFXL METER BOX WITH OLDCASTLE #0200158S, FIBRELYTE FL36P, SOLID BLACK LID WITH EMBEDDED REBAR, MARKED "WATER METER", 4 1/8" X 5/16" RECESS, 2" HOLE, OR APPROVED EQUAL. OLYMPIC FOUNDRY SM30, OR APPROVED EQUAL, IN SIDEWALK AND IN AREAS WITH VEHICULAR TRAFFIC. LID TO HAVE 3/4" HOLE DRILLED THROUGH FOR AMR, SEE LID DETAIL BELOW.
- TWO PIECE CAST IRON VALVE BOX TO FIT, RICH SEATTLE TYPE #045 WITH RECESSED HANDLE LID, OR APPROVED EQUAL. SEE DETAIL W-11.
- (L) 2" PLASTIC AMR PLUG, FORD METER BOX CO. MODEL PTP-BR-3-25 IF OLDCASTLE LID IS USED.

NOTES:

- SERVICE LINE SHALL BE PERPENDICULAR TO THE WATERMAIN, UNLESS OTHERWISE APPROVED BY THE ENGINEER.
- BYPASS WILL BE LOCKED OFF BY CONSTRUCTION INSPECTOR WHEN METER SPREADER IS INSTALLED.
- METER WILL BE SUPPLIED AND INSTALLED BY THE CITY OF BELLEVUE.



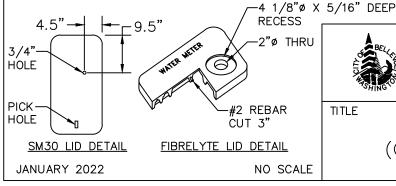

WATER UTILITY

TITLE

2" DOMESTIC WATER SERVICE (COMMERCIAL AND MULTI-FAMILY)

NO. W-30