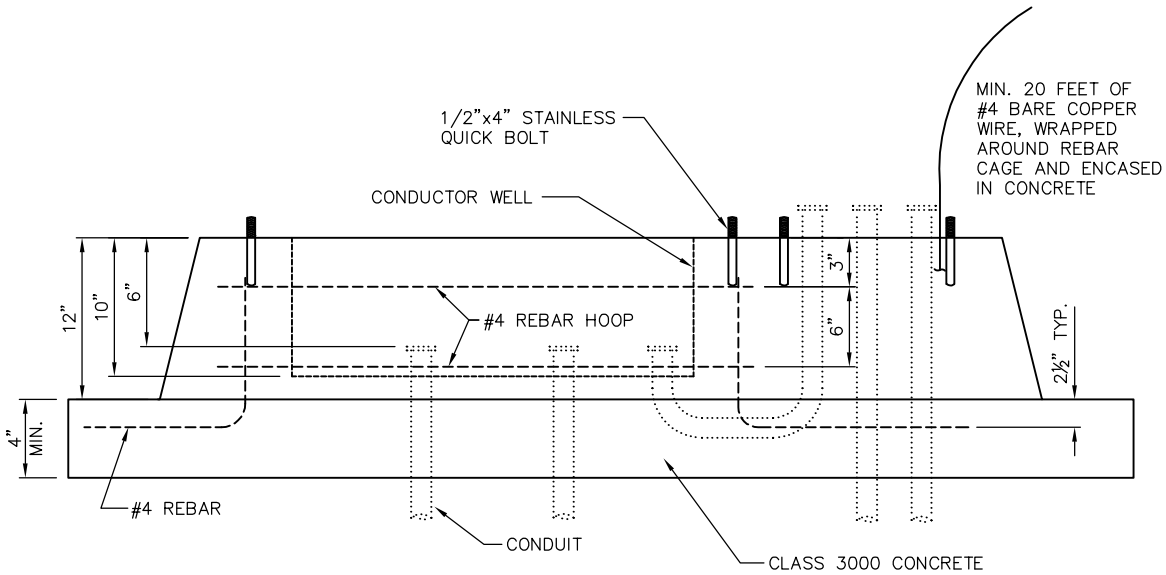

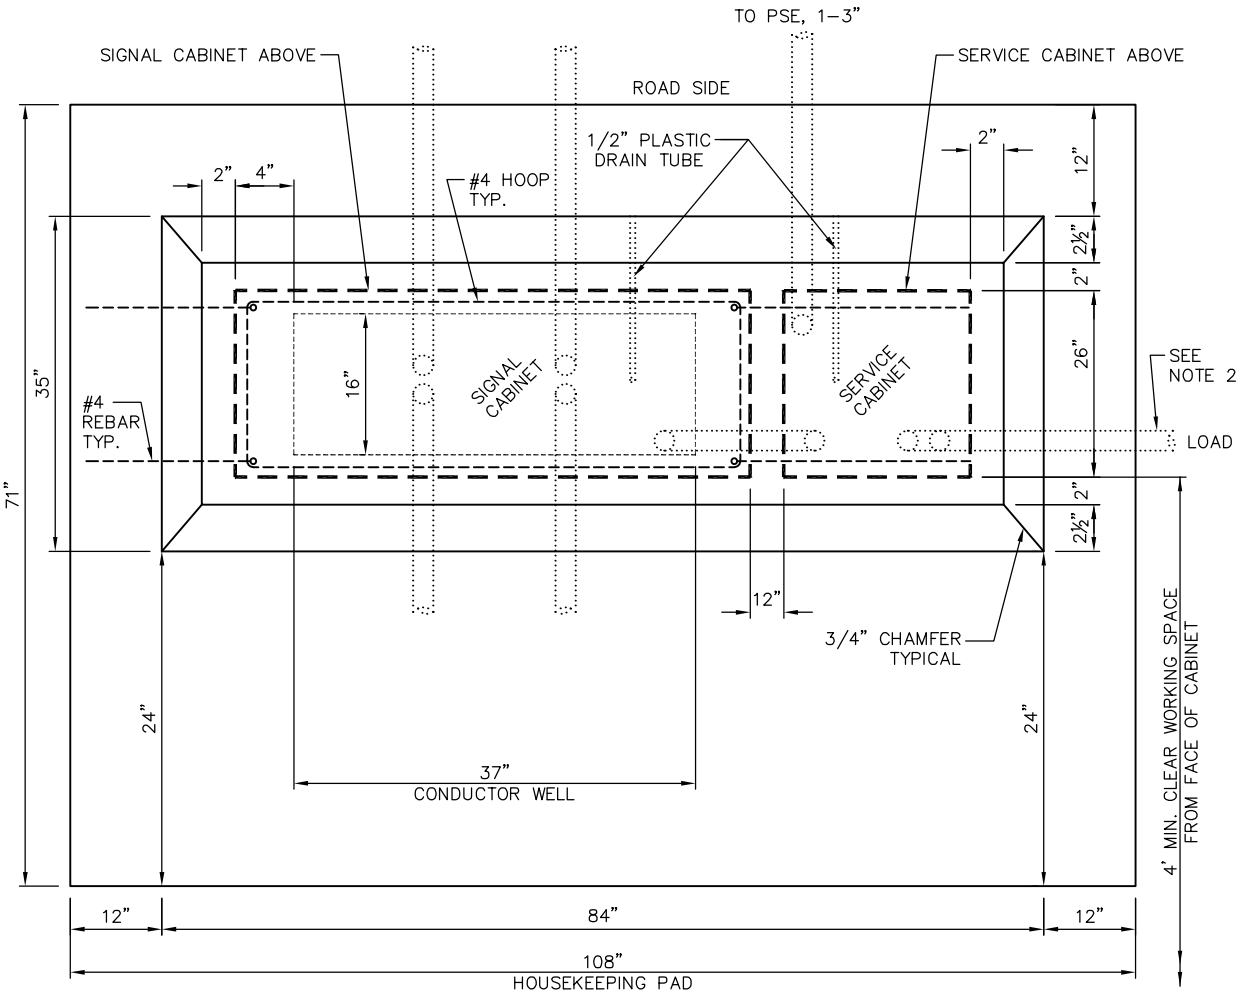

NOTES:

1. CONTRACTOR TO VERIFY BOLT PATTERN WITH CABINETS.
2. MINIMUM 2-2" CONDUITS. FOR CONDUIT LOCATION SEE SERVICE CABINET DETAIL, STD DWG SL-220-1

NEMA CONTROLLER CABINET AND SERVICE CABINET FOUNDATION DETAIL

DRAWING NUMBER	SL-210-1
SCALE	NONE
REVISION DATE	4/21
DEPARTMENT	TRANS

SIGNAL AND SERVICE CABINET FOUNDATION DETAIL

City of Bellevue